

RESIDENTIAL SHOWER RECEPTOR


2016 CALIFORNIA PLUMBING CODE SECTIONS 408.1 TO 408.7.1

The following is a list of general requirements for the install or replacement of shower receptors based on the 2016 CA Plumbing Code; contact the Building and Safety Division for further questions and concerns.

GENERAL SHOWER ENCLOSURE STANDARDS

There are a number of size, configuration, and construction standards for showers which are listed below:

- Minimum interior dimension = 30"
- Minimum interior area = 1,024 square inches
- Waterproof wall finishes must extend a minimum 70" above shower drain.
- Shower heads must discharge below the top edge of waterproof wall finish.
- Control valves must be of the pressure balance or thermostatic mixing valve types.
- Hinged shower doors must swing outward.
- Floor slope for drainage must be a minimum 1/4" to maximum 1/2" per foot.

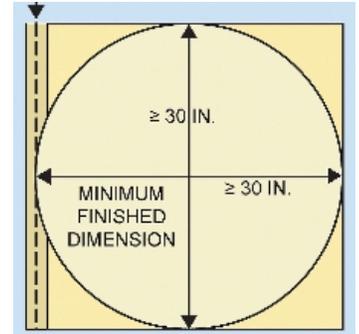

APPROVED CONSTRUCTION OF TILE LINED SHOWER RECEPTORS

